REV	DESCRIPTION	DATE	APPROVED

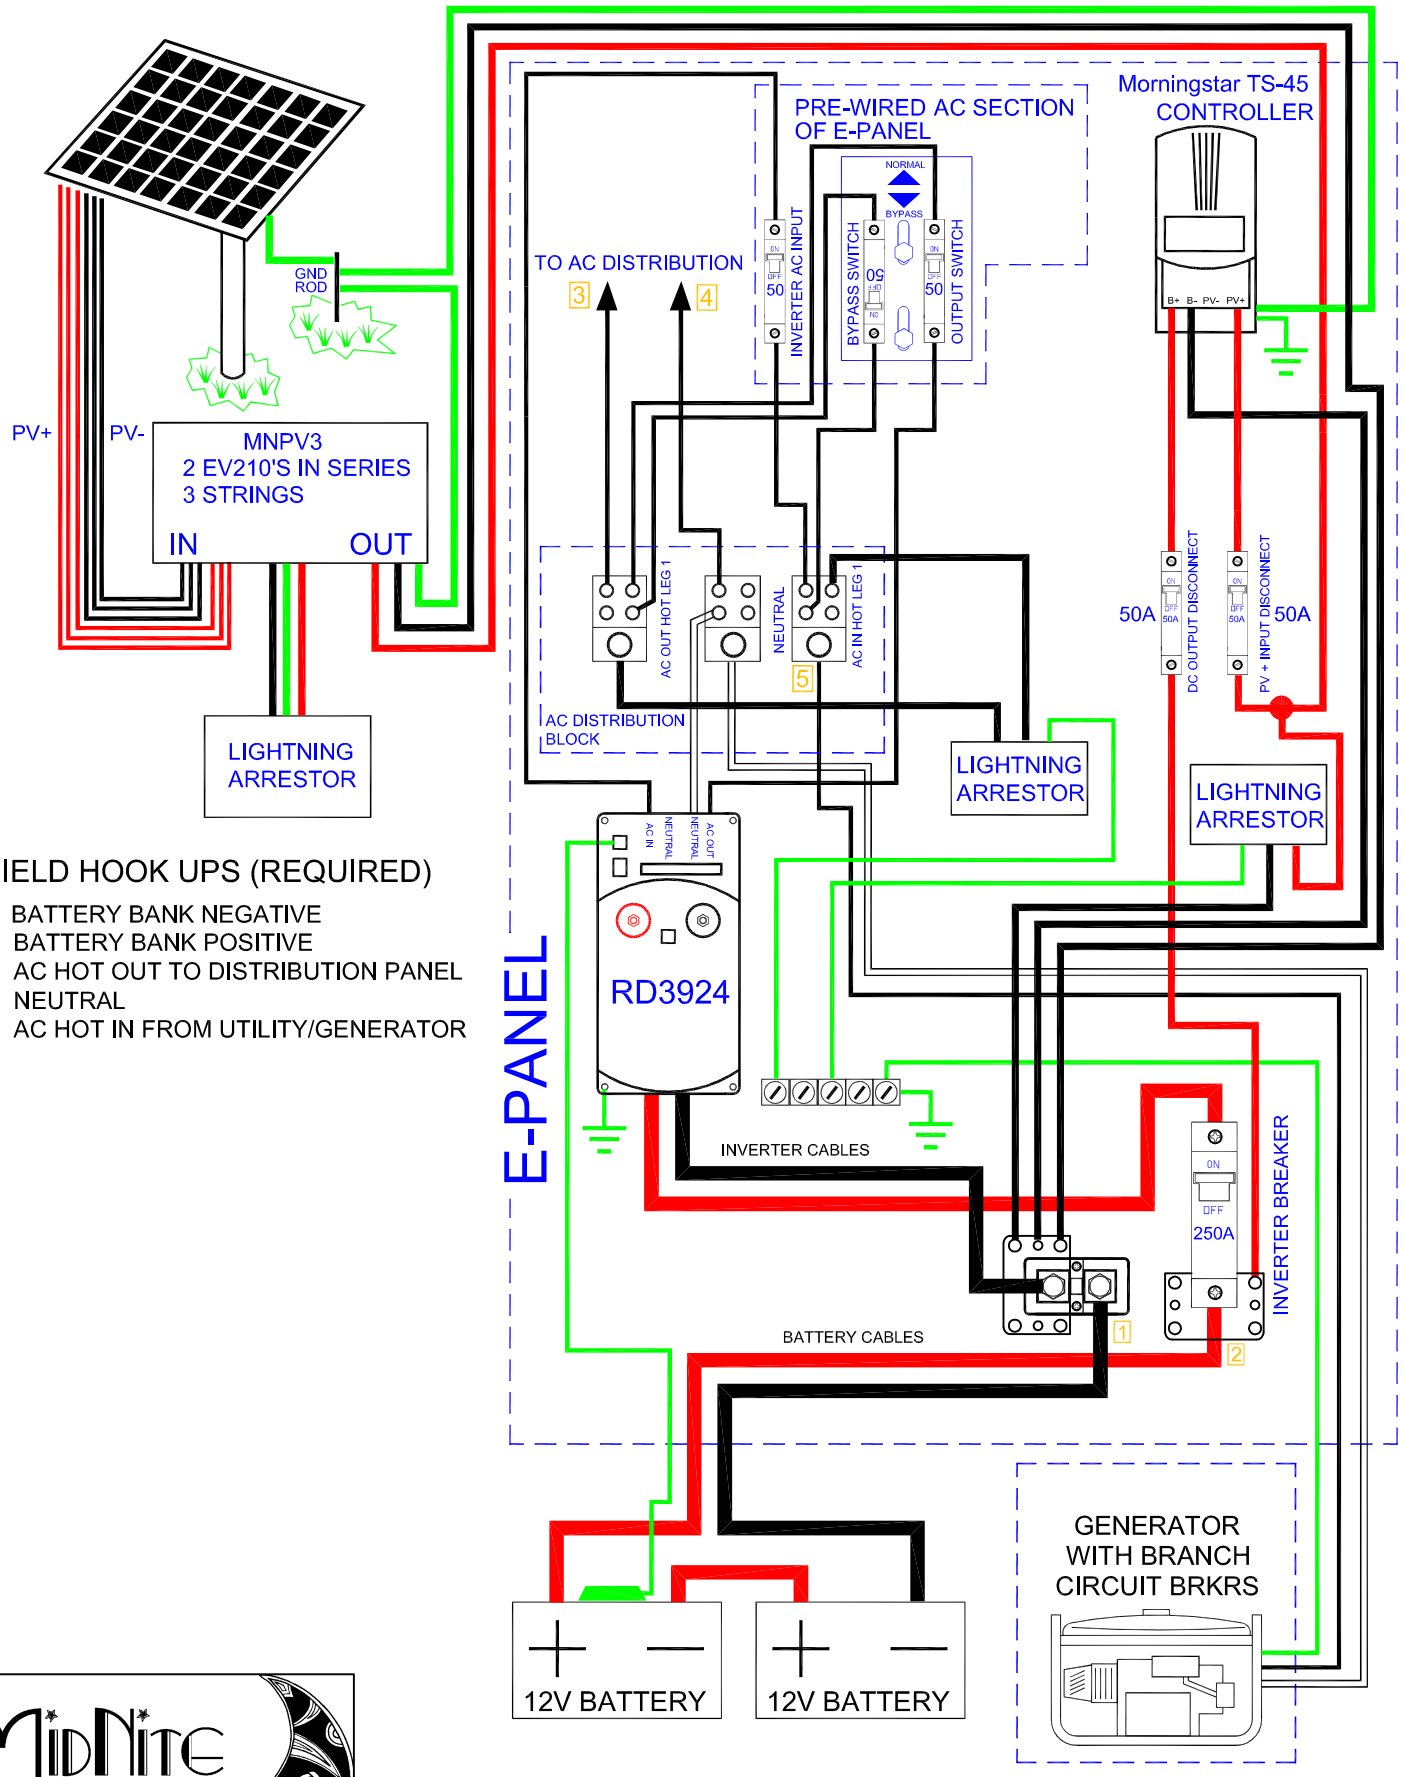

FIELD HOOK UPS (REQUIRED)

1. BATTERY BANK NEGATIVE
2. BATTERY BANK POSITIVE
3. AC HOT OUT TO DISTRIBUTION PANEL
4. NEUTRAL
5. AC HOT IN FROM UTILITY/GENERATOR

MIDNITE SOLAR, INC

N RD
N, WA

E-PANEL DIAGRAM

DRAWN BY ROBIN GUDGEL	6-03-11	E-PANELWIRE MAG RD3924.DWG	1 of 1